



TANK COMPONENT WEIGHTS (APPROXIMATE)


TOP SECTION: 43,000 LBS.
 BOTTOM SECTION 43,500 LBS.

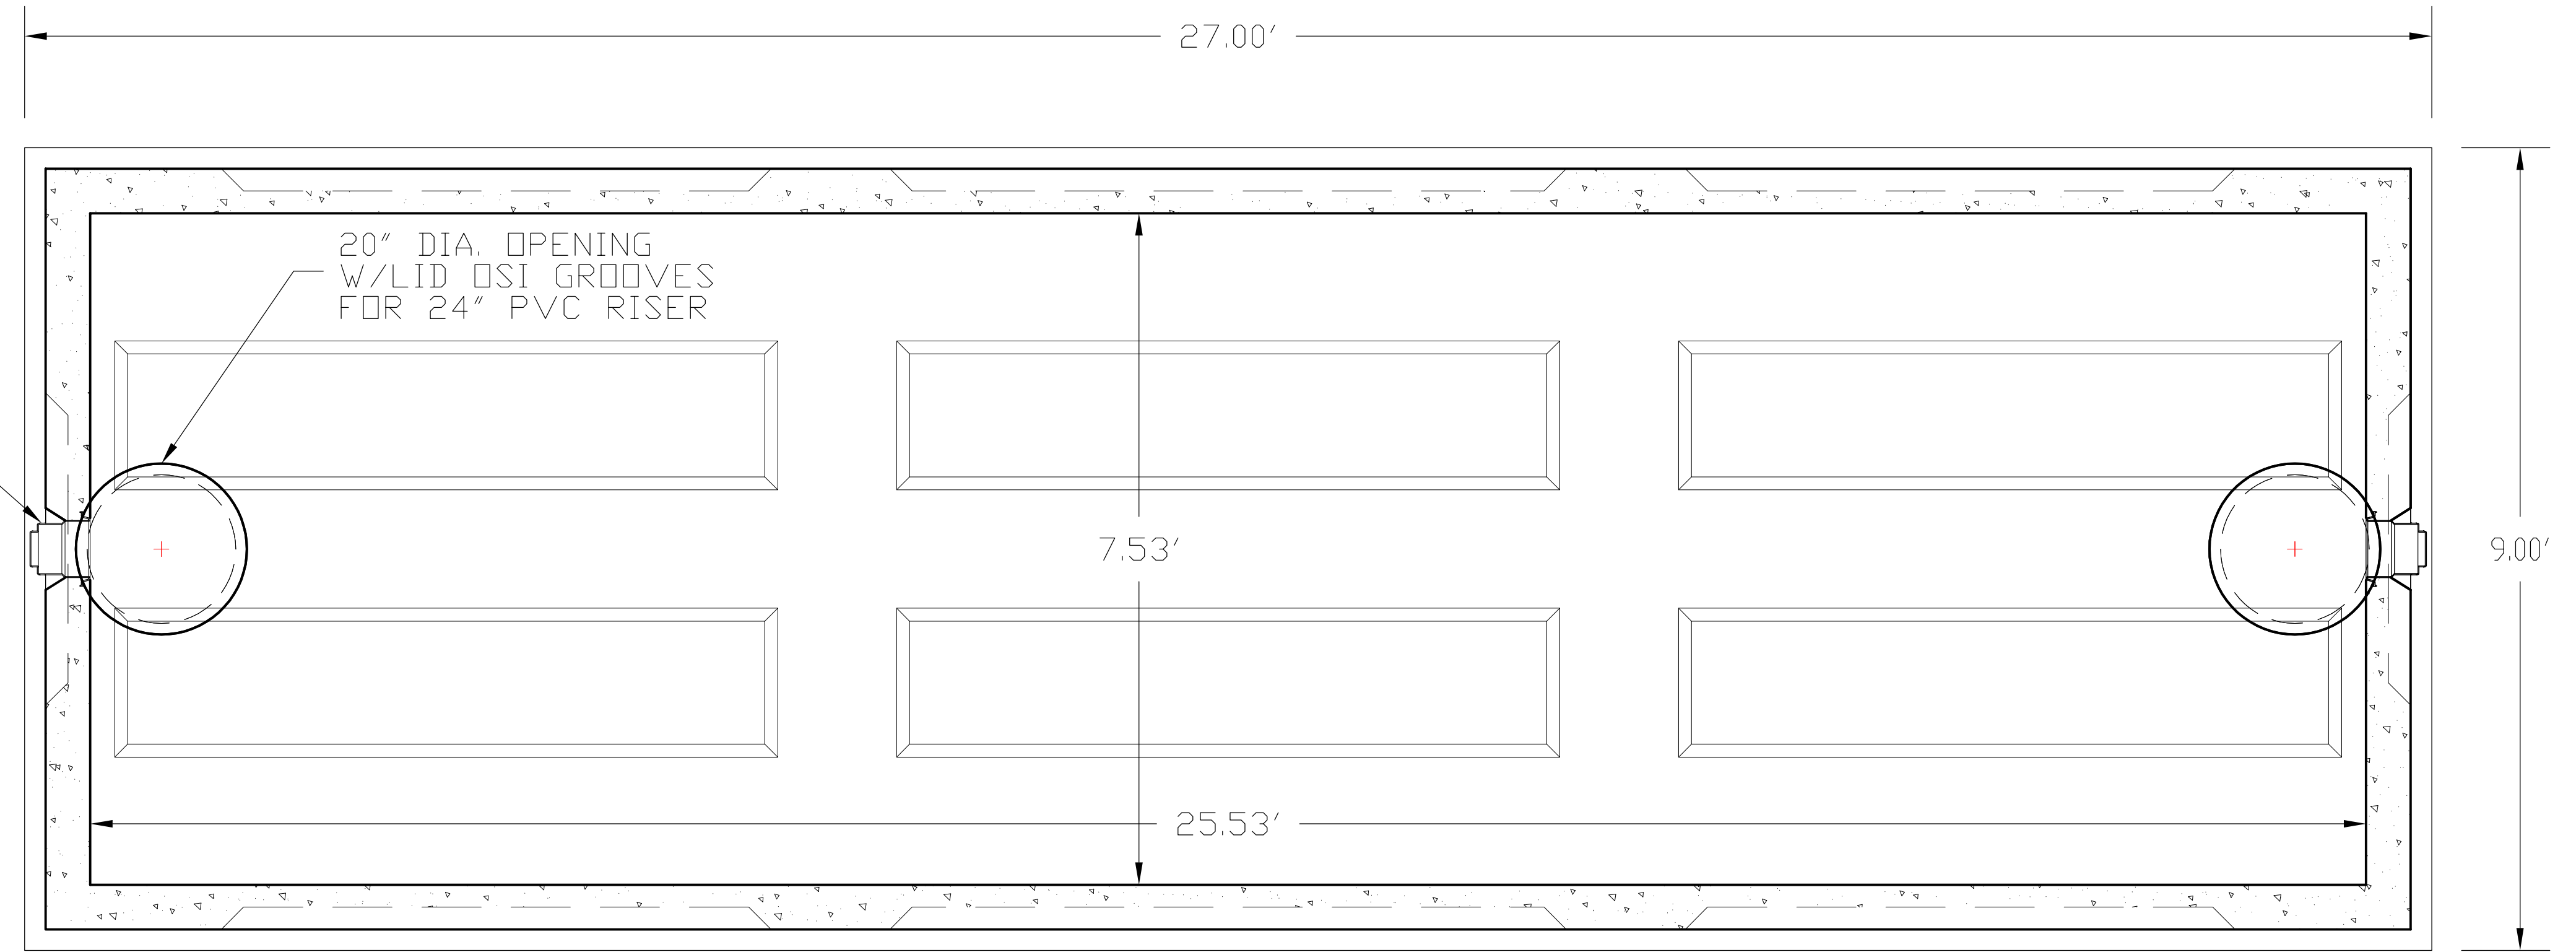

PLAN VIEW

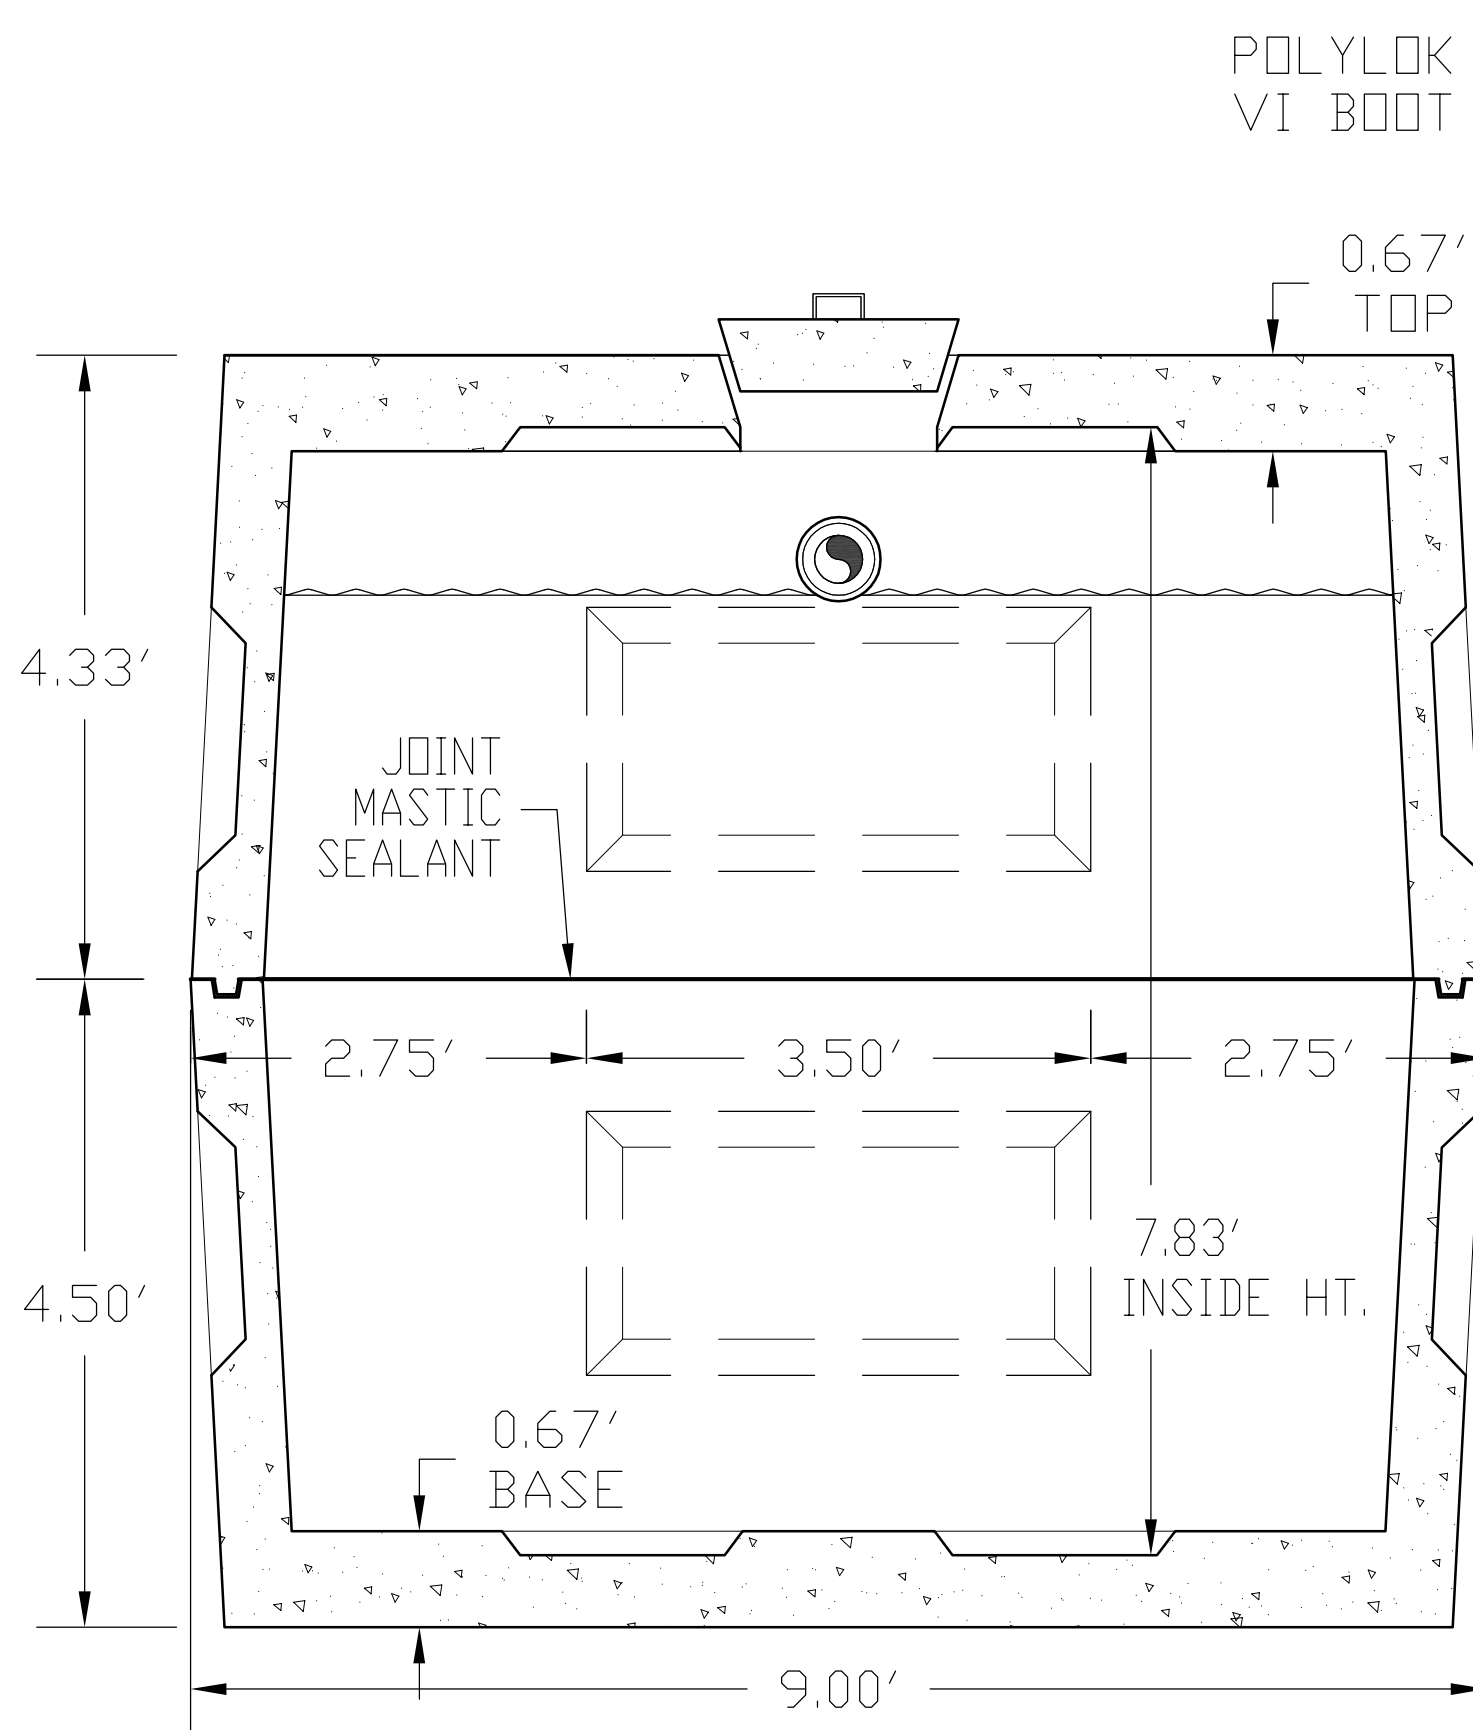

END SECTION VIEW

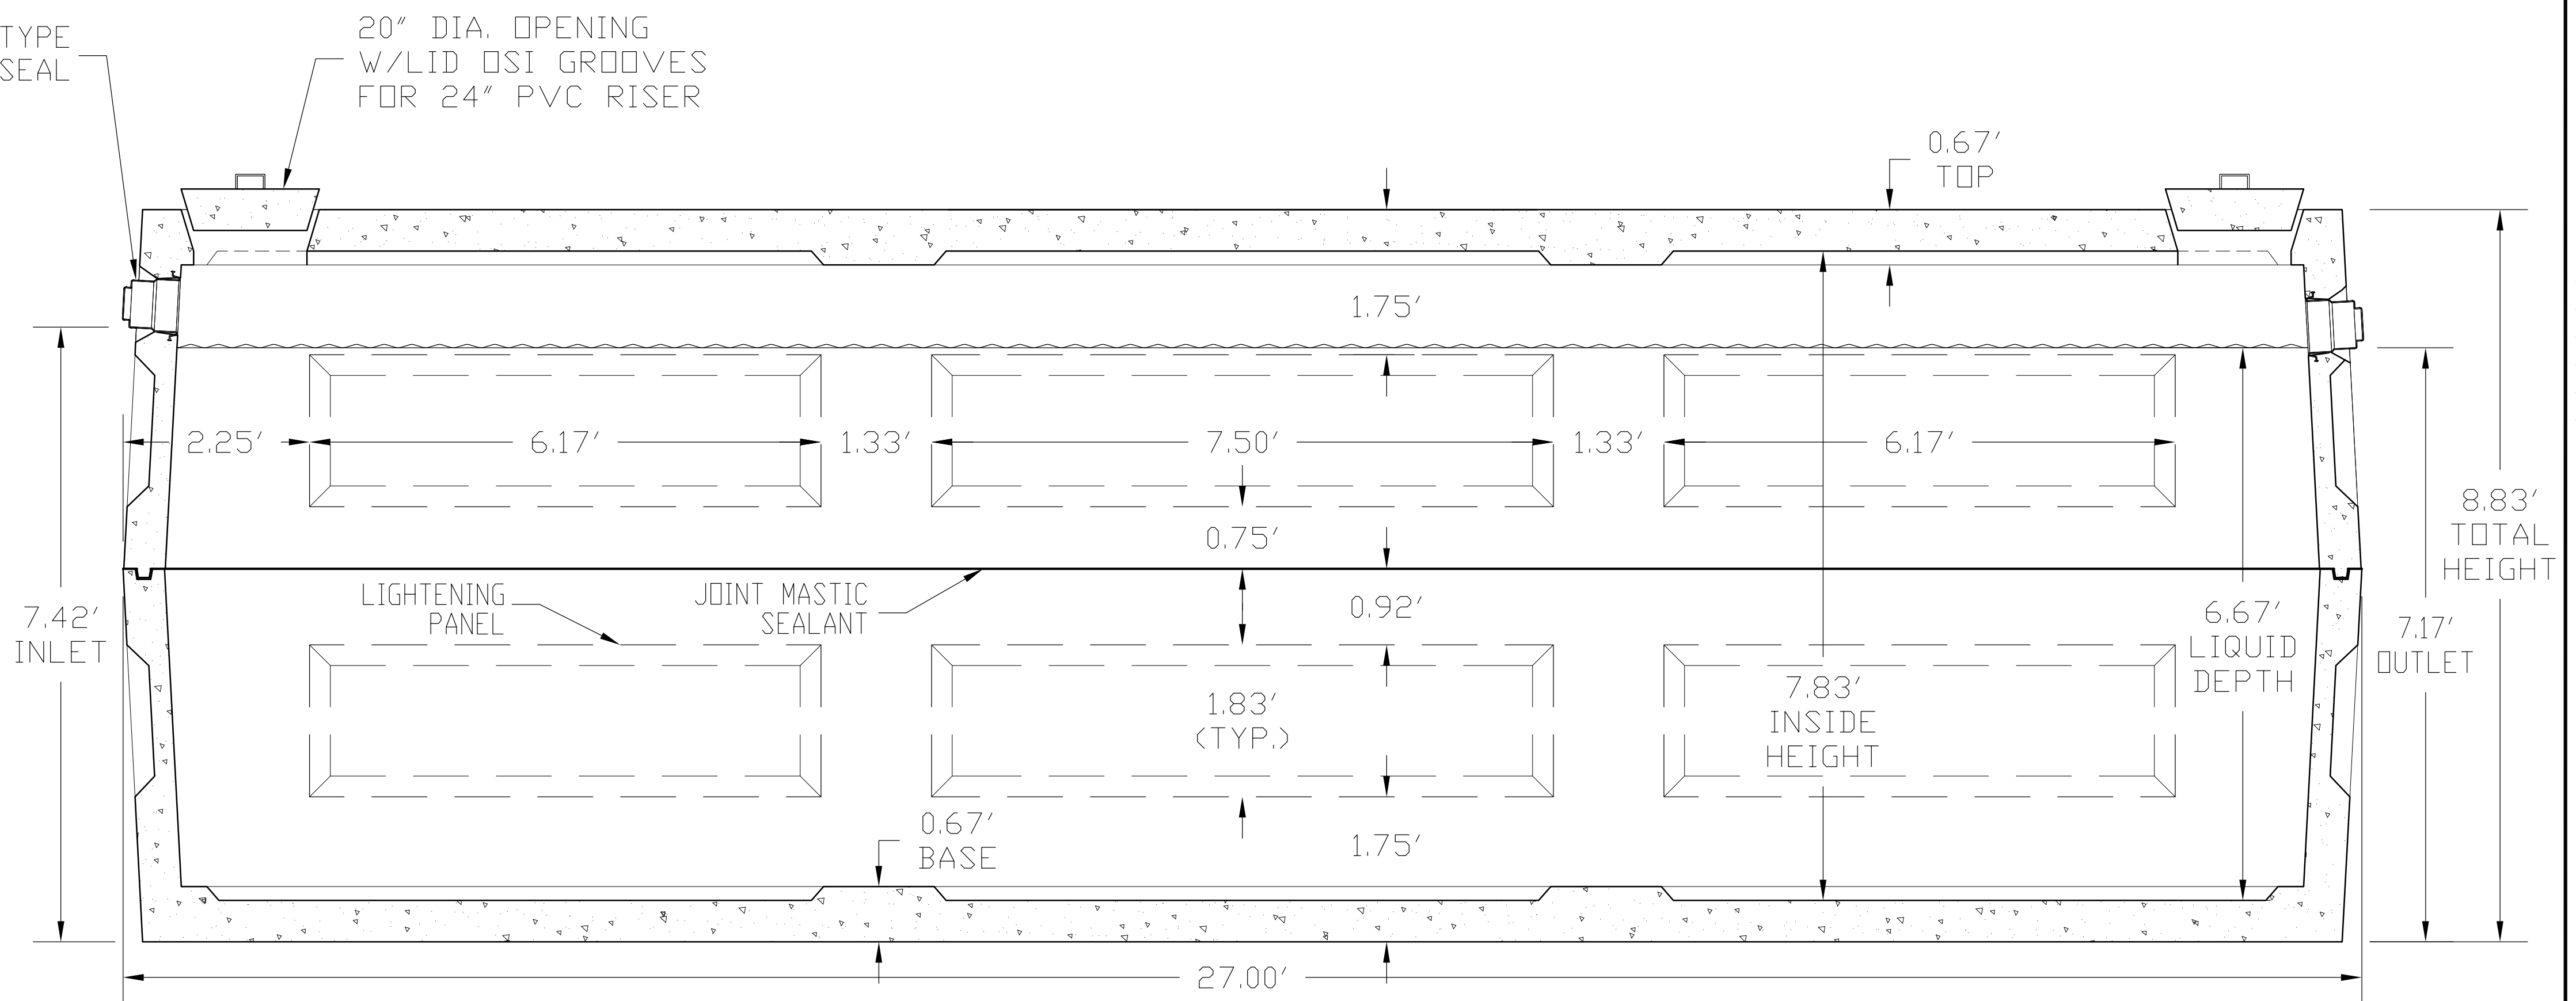

SIDE SECTION VIEW

10,000 GALLON TANK

Engineer's Stamp

Engineer

Contractor

Project Name and Location

PROJECT NAME

PROJECT LOCATION

Issued / Revised

Drawing Title

10,000 GALLON SEPTIC/DOSE TANK NON-TRAFFIC

PROJECT NOTES:

GENERAL CONSTRUCTION NOTES:
 CONCRETE IS 5000 PSI @ 28 DAYS.
 CEMENT IS TYPE V, WITH MAX C3A OF 8%, PER MT DEQ-4. SET IN PLACE W/CONSEAL CS-102 OR CS-202 RHEMAC 3000 WATERPROOFING USED. REINFORCEMENT - PER ENGINEER. MAXIMUM EARTH COVER IS 6'-0" FEET. THIS TANK MUST BE PLACED ON COMPACTED 3/4" ROAD-BASE OR SIMILAR MATERIAL. MINIMUM RELATIVE COMPACTION IS 95%. DO NOT USE FLOWABLE BACKFILL MATERIALS SUCH AS 3/4" WASHED GRAVELS. TANK MUST BE BACKFILLED TO TOP BEFORE WATERTESTING. BUILT TO MT DEQ-4.

Sheet No.

Drawn By: **MAP N.T.S.**